


WOOD PELLET FEEDING SYSTEM

Vacuum wood pellet feeding max up to 90 kW boiler heat output

HEATING TECHNIQUE

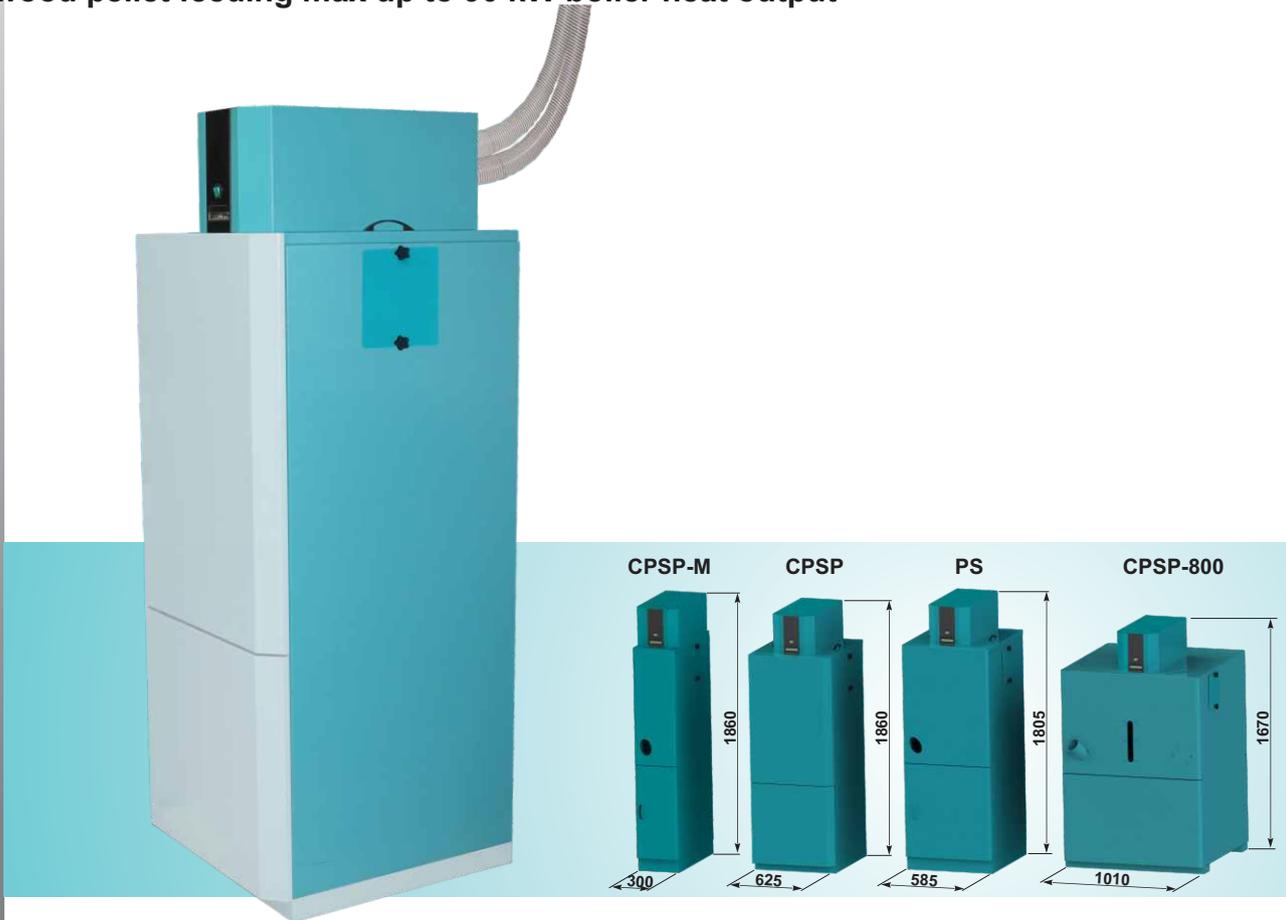




Vacuum wood pellet feeding

Vacuum wood pellet feeding is designed for wood pellet systems max up to 90 kw heat output where pellet storage is not beside the boiler and it is needed the automatic pellet feeding. With help of flexible tubes, max length up to 10 met in one direction, the wood pellets is transported from the large storage to the tank beside the boiler to be able to ensure the continuous pellet feeding of the boiler.

Vacuum wood pellet feeding consists of the turbine which is mounted on the pellet tank beside the boiler, filling level sensor in the pellet tank beside the boiler (PELTEC has already sensor installed) flexible feeding tube with earth leading wire, up to max length of 10 met in one direction and up to max difference in height from 2,5 to 5 met, depending of total length of the tube and larger pellet tank. Control unit steer with vacuum wood pellet feeding, which according to the sensor in the pellet tank and the turbine and set operation times steers with operation of the vacuum wood pellet feeding.

Wood pellet feeding system could be connected on the three different type of pellet storage: pellet storage with mole, large pellet tank CentroPellet Box and pellet tank with the feeder screw (transporter).

System has been tested for supplying wood pellets 6mm diameter made according to DINplus or ENplus, with dust maximum share of < 0,7%.

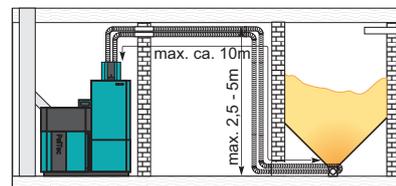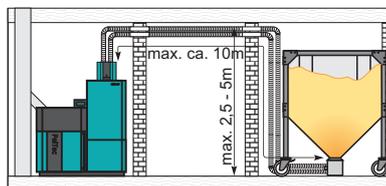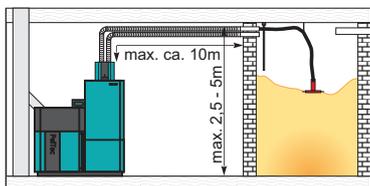

Centrometal d.o.o. - 40306 Macinec - Glavna 12 - Croatia - tel:+385 (0)40 372 600 - fax:+385 (0)40 372 611
Branch office - 10000 Zagreb - Babonićeva 53 - Croatia - tel:+385 (0)1 46 33 762 - fax:+385 (0)1 46 33 763

<http://www.centrometal.hr>

e-mail: komercijala@centrometal.hr


Centrometal

Vacuum wood pellet feeding characteristic:s

- Maximum length of tube for pellets feeding is 20met + 5 met in the storage (the distance from the storage to the boiler is approximately 10met of the feeding tube length), the maximum difference in height of the tube (H) for feeding depends on the length of the tube (L) (flow and return): $L = 15\text{m}$, $H = 5\text{m}$; or $L = 20\text{m}$, $H = 2.5\text{m}$.
- Difference in height of the feeding tube larger than 3 meters must be terminated with a minimum of 1 meter horizontally laid tube.
- The tube must be laid with the maximum possible arcs. Bending radius must be minimum 30 cm.
- System has been tested for supplying wood pellets 6mm diameter made according to **DINplus** or **ENplus**, with dust maximum share of $< 0,7\%$.
- Storage must be air-tight, to restore the dust from the turbine. If storage is not air-tight, the backflow tube must be fitted to the dust bag.


Vacuum wood pellet feeding with mole from the storage/room

Mole is an innovative technique feeding of pellets from the pellet storage/room to daily tank. Standard systems for feeding of the wood pellets feeds pellets from the bottom of the tank (pellets moving downward) while the mole takes pellet always on the top side of the storage (pellet standstill, mole is moving). In standard systems of feeding storage for wood pellets must have slope sides that take away valuable space for storage, and the mole is used almost the entire volume of storage (residue max 10 %). Mole is intended for storage footprint dimensions up to max. 2.5 x 2.5 meters, in height storage 1.8 to 2.5 met. In these dimensions storage can be circular or rectangular in shape. For larger footprint dimensions of the storage is necessarily with slope sides at an angle of 45 ° adjust the room surface up to the maximum allowed. Storage of pellets may be filled to the max. 30 cm below a ceiling. Recommendation is to fulfill the storage with truck for delivering the pellets, which will fulfill storage evenly, with the lowest percentage of dust (it is needed to install Set of the tubes for filling the room with wood pellets and rubber impact protection blind).

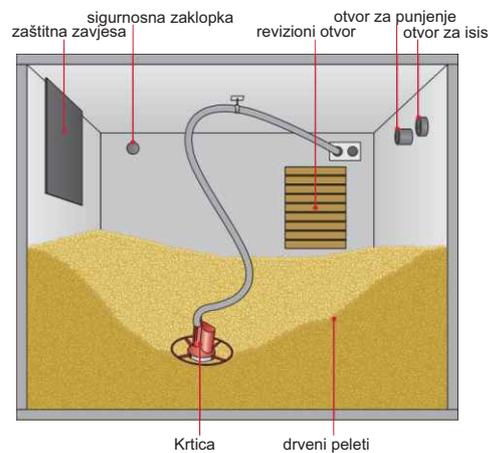


Vacuum pellet feeding from the large pellet tank

In the central heating system fired with wood pellets by the boiler it is obligatory to have a tank for the wood pellets. Depending of the heat output and wished operation autonomy, pellet tank sometimes need to be bigger dimensions, which require larger boiler rooms. To resolve the problem of the small boiler room i.e. shortage of the storage space for wood pellets beside the boiler and also to enlarge the comfort with wood pellet firing with help of vacuum feeder screw from the larger tank to the daily tank placed closed to the boiler the wood pellet can be transported up to 10 met of the length of the flexible tube. Tanks can be various volumes CentroPelet box 1,5 m³, 2,7 m³, 3,4 m³ and 4m³, with inbuilt box for vacuum pellet feeding. CentroPelet box tank distance from the boiler can be maximum 10 met of the length of the flexible tube for wood pellet feeding.

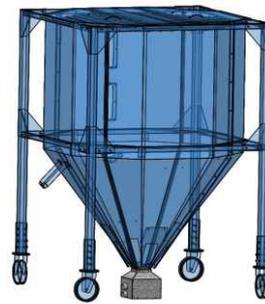

Vacuum pellet feeding with the feeder screw (transporter) from the room/storage

Length of the feeder screw for the feeding of pellets from the room can be 2 m, 3 m, 4 m and 5 and according to this must be set the slope within the room, the inclination 45°. Room distance from the boiler can be maximum 10 met of the length of the flexible tube for wood pellet feeding.

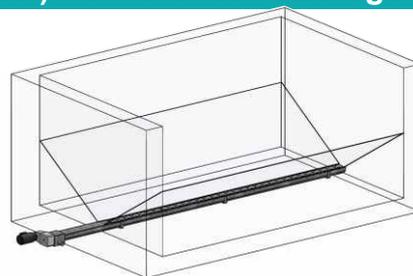

Centrometal d.o.o. shall not be responsible for possible incorrect data caused by printing errors or error made in transcription. We reserves the right to modify its products as deemed to be required and useful without any prior notification. Images may not correspond to actual products.

Centrometal d.o.o. - 40306 Macinec - Glavna 12 - Croatia - tel: +385 (0)40 372 600 - fax: +385 (0)40 372 611
Branch office - 10000 Zagreb - Babonićeva 53 - Croatia - tel: +385 (0)1 46 33 762 - fax: +385 (0)1 46 33 763

<http://www.centrometal.hr>

e-mail: komercijala@centrometal.hr

PVD-6/2015

TEHNIKA GRIJANJA
Centrometal

PARTS AND ADDITIONAL EQUIPMENT


	Code
Turbine with suction tube	31884

Turbine with flap and control unit, 20 meters flexible antistatic suction tube with cable for earthing, rubber cable for electricity and clamps.



Parts for daily tank	Code
Cover of the daily tank for connection point of the turbine.	PelTec 31905

Lateral daily tank side with revision opening.

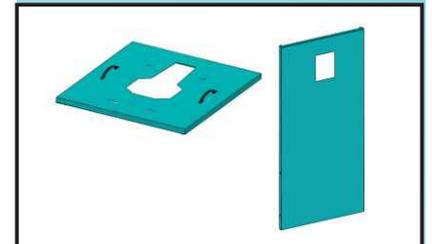

	Code
Cover of the daily tank with place for turbine connection.	CPSP-M 31907
Lateral side of the daily tank with revision opening.	CPSP-370 31908
	CPSP-800 31906

Fuel level sensor, sensor guide, addition to control unit, cable fastening

Back side of the tank with defined position of the sensor.




	Code
Mole	30663

Mole with electric motor 5 m flexible antistatic suction tube, rubber cable for electricity, adapter plate which goes through the storage wall with 2 connections DN50, various small parts (screws, clamps, etc).




Feeding box from the Centropelet box	Code
- 1 turbine	36135
- 2 - 4 turbines	37873

Box for vacuum suction system for wood pellets from the large tank Centropellet box volume 1,5 m³, 2,7 m³, 3,4 m³ i 4 m³, various small parts (screws...).

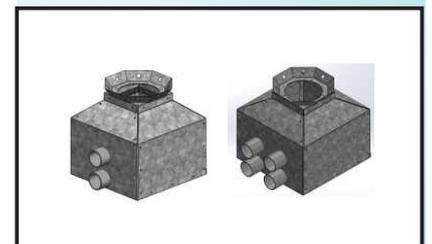

Feeder screw (transporter) from the storage/room	Code
2 m	36136
3 m	36137
4 m	36138
5 m	36139

Feeder screw (transporter) for extraction of the wood pellet with reception box and motor with a gear box for vacuum suction system for wood pellet from the storage/room, length for 2, 3, 4 and 5 m.

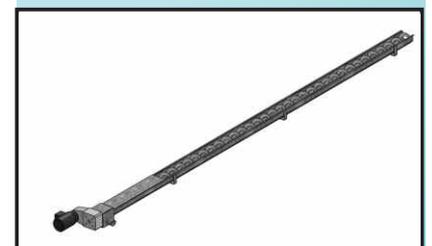

	Code
Pellet suction tube	31885


Flexible, antistatic suction tube for transporting wood pellets from the storage/room to the daily tank with earth lead wire, in ring, length 20 meters, DN 50.



PARTS AND ADDITIONAL EQUIPMENT

	Code
Clamp	35202

Metal clamp for feeding tube DN50.

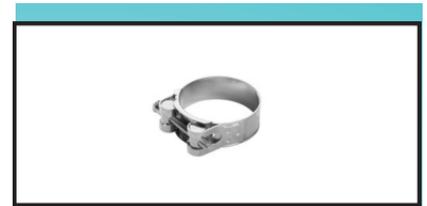

	Code
Cable for mole connection	31887

15 m of cable for electricity with connector IP67 for connection with the mole.



	Code
Dust bag	31888

Dust bag when operating vacuum suction system, it is used if the pellet storage is not air-tight.



	Code
Set of the tubes for filling the storage/room with wood pellets	31889


Set of the tubes for filling the storage/room with wood pellets with truck with lids, flat connection.



Galvanized pipes and elbows

Galvanized pipes and elbows DN100, L=250, 500, 1000 and 2000 mm, 15°, 30°, 45°, 90°.

	code	(€)		code	
pipe L-250 mm	31891	12,10	elbow 15°	31895	
pipe L-500 mm	31892	14,20	elbow 30°	31896	
pipe L-1000 mm	31893	21,90	elbow 45°	31897	
pipe L-2000 mm	31894	33,90	elbow 90°	31898	

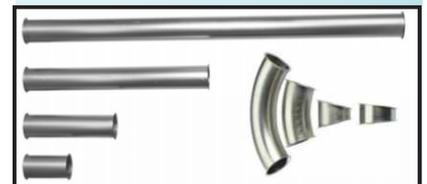

	Code
Rubber impact protection blind	31899

Rubber protection blind for storage of pellets at truck loading, measuring 120x100 cm, thickness 3 mm.



	Code
--	------

Tanks pellet volume: 1,5 m³, 2,7 m³, 3,4 m³ i 4 m³, with a capacity: 900 kg, 1.700 kg, 2.200 kg and 2.600 kg of wooden pellets.

1500	38342
2700	14537
3400	21296
4000	23216

